














Report

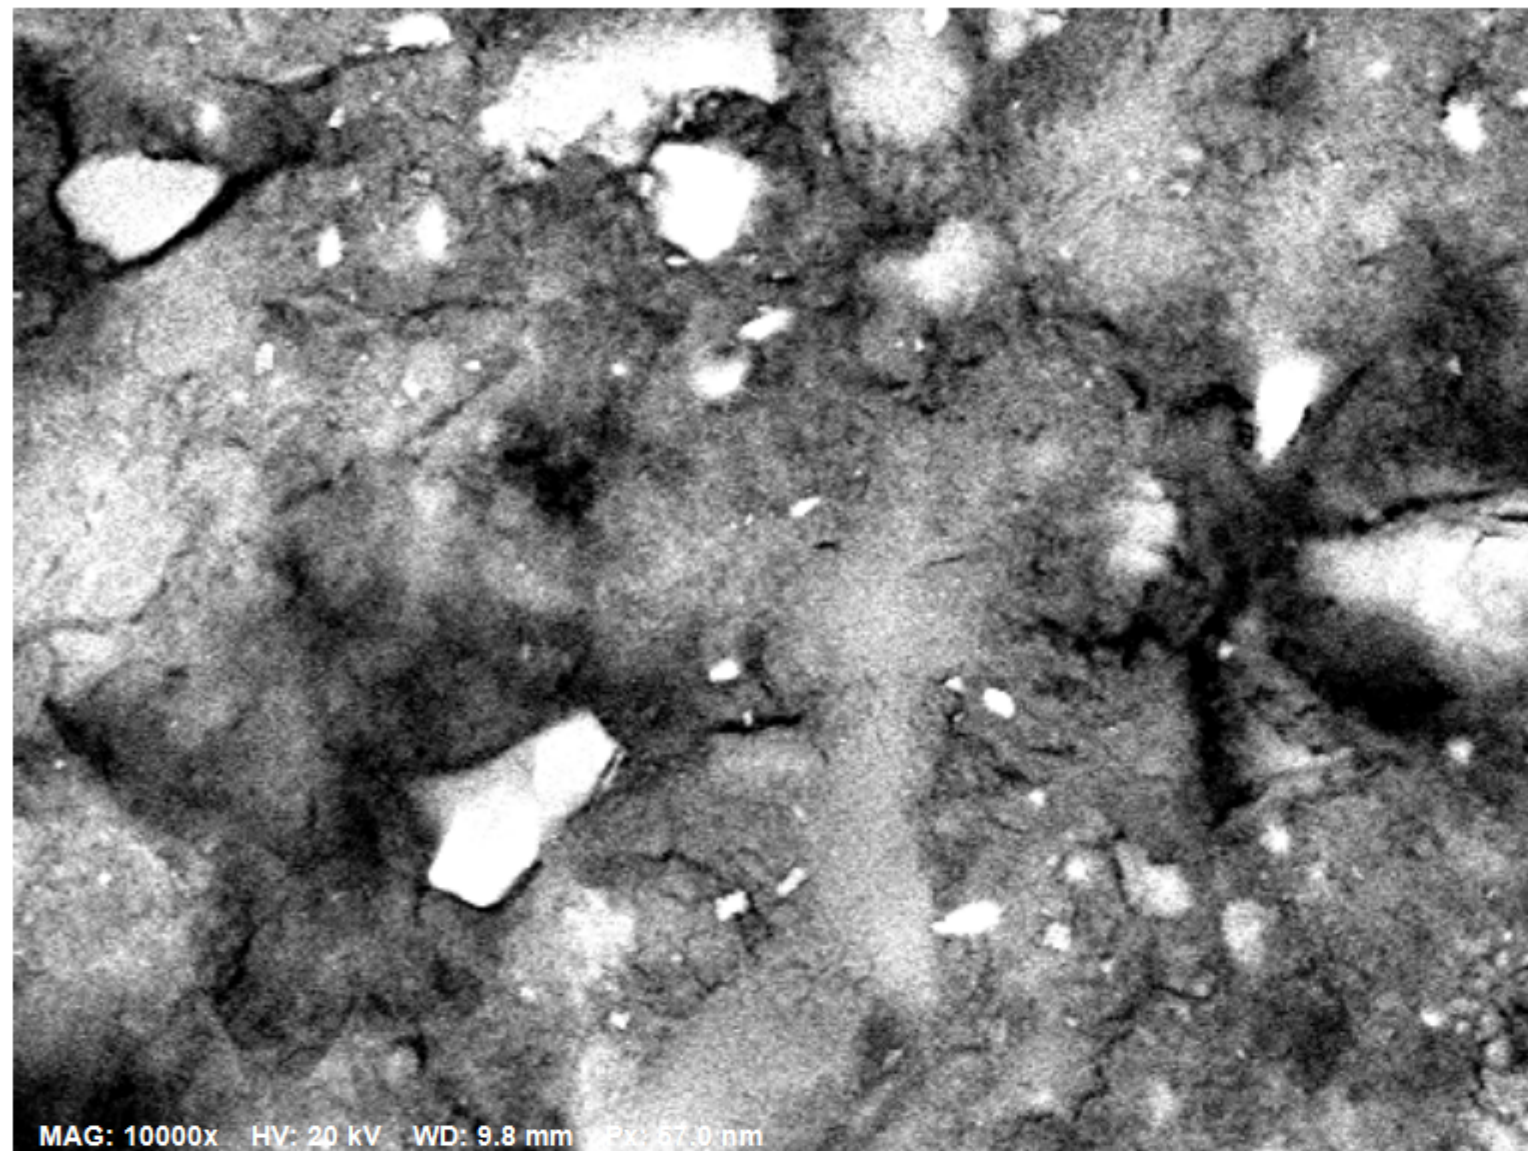

Name	Date	Time	HV [kV]	Mag	WD [mm]
Ch 0	4/9/2020	8:37:51 AM	20.0 keV	10000x	9.8 mm

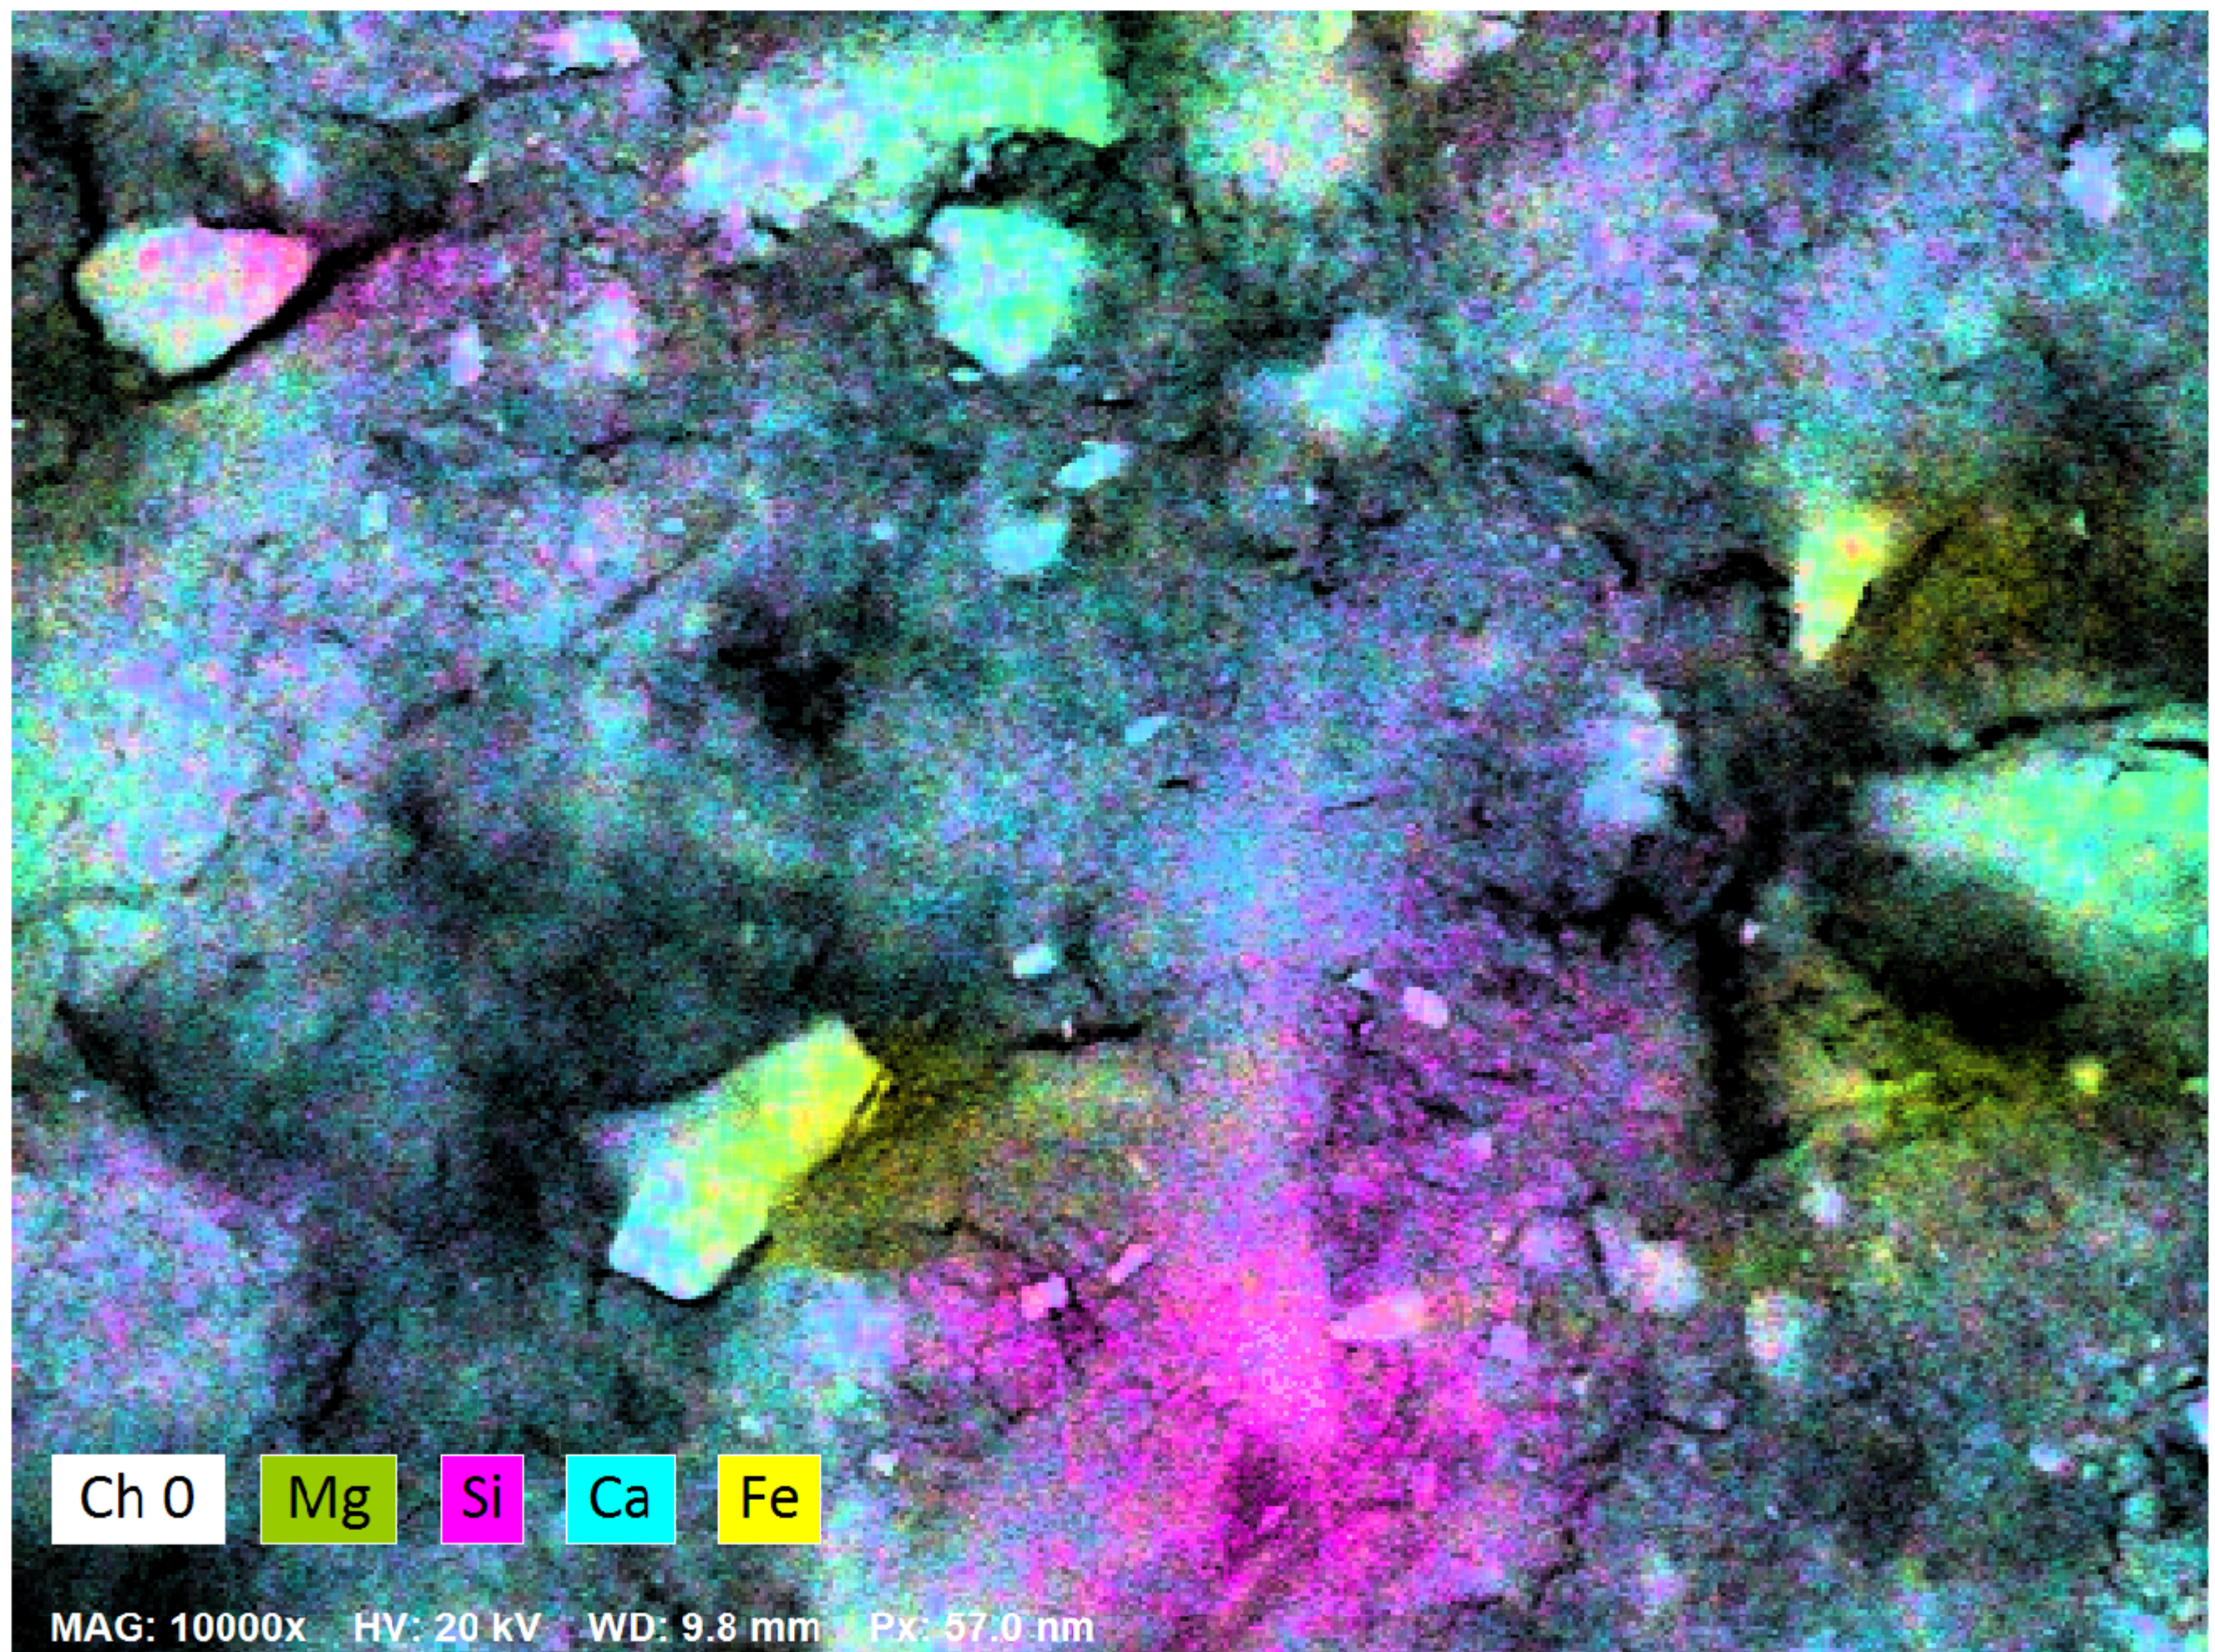


Date	Time	HV [kV]	Mag	WD [mm]
4/9/2020	8:37:51 AM	20.0 keV	10000x	9.8 mm
4/9/2020				

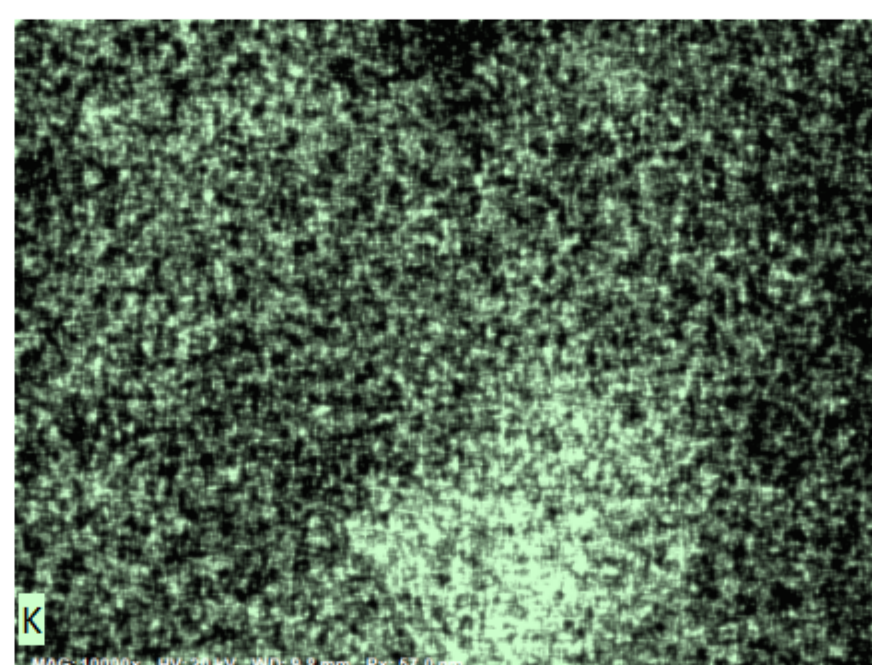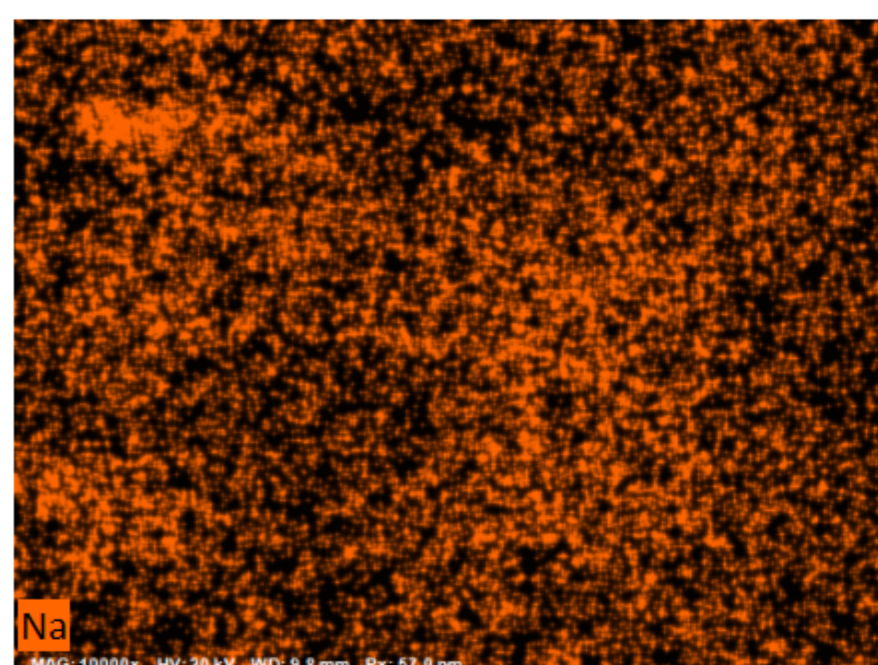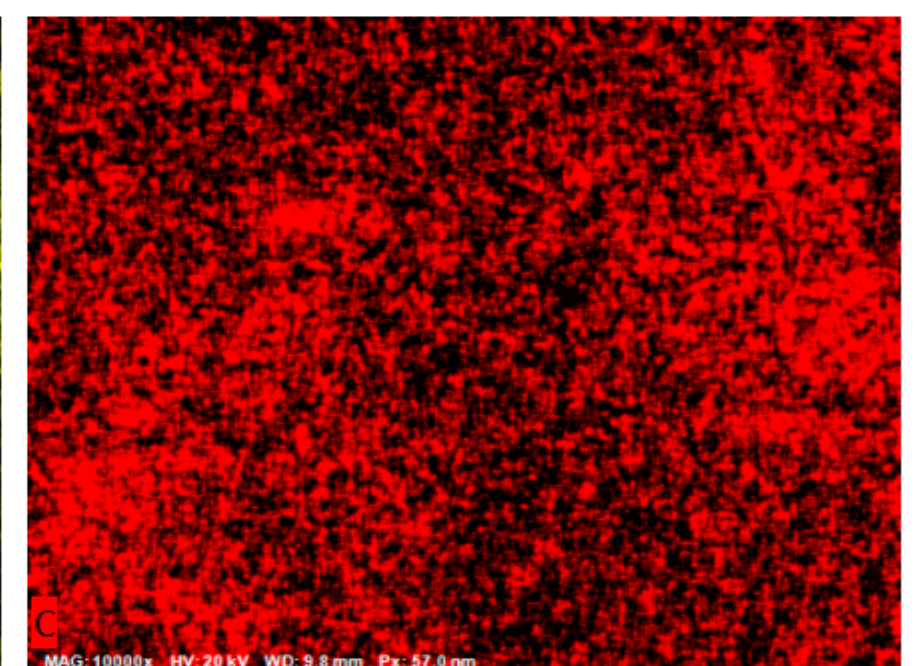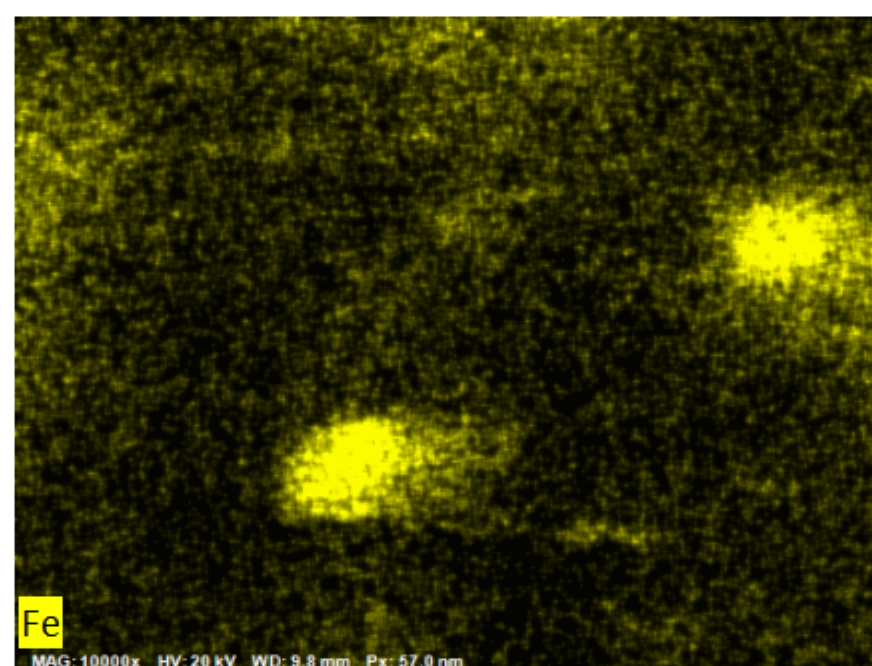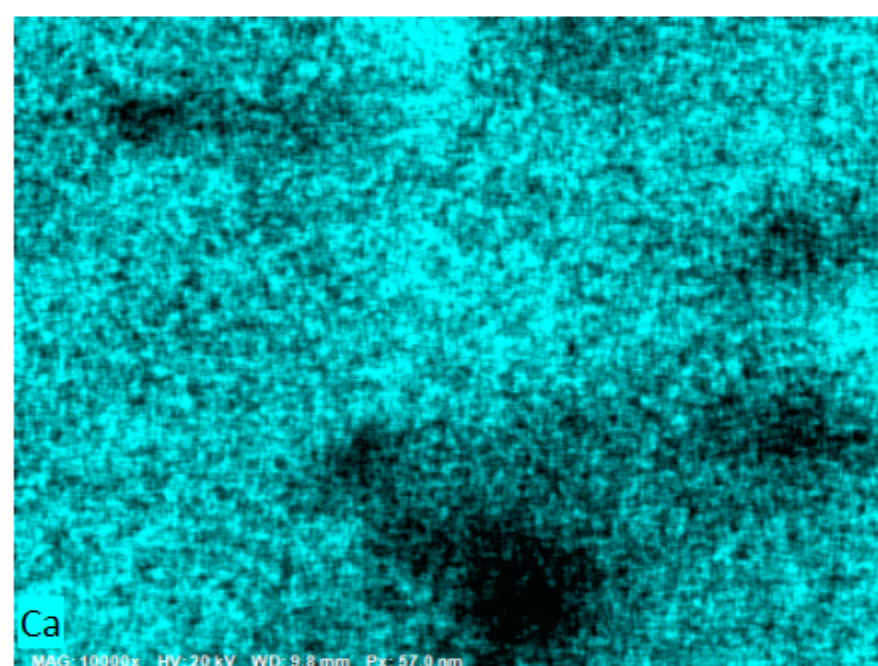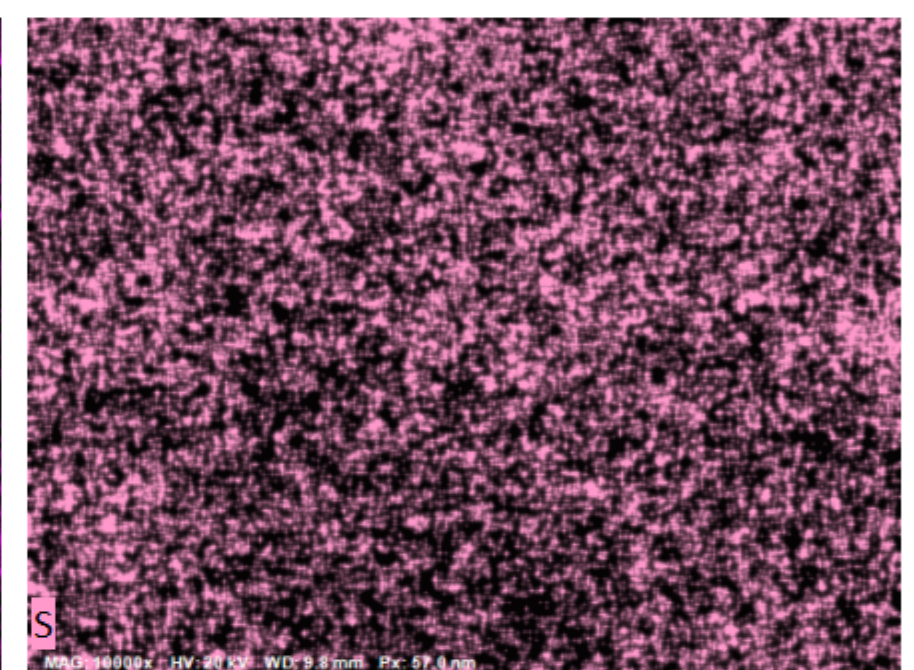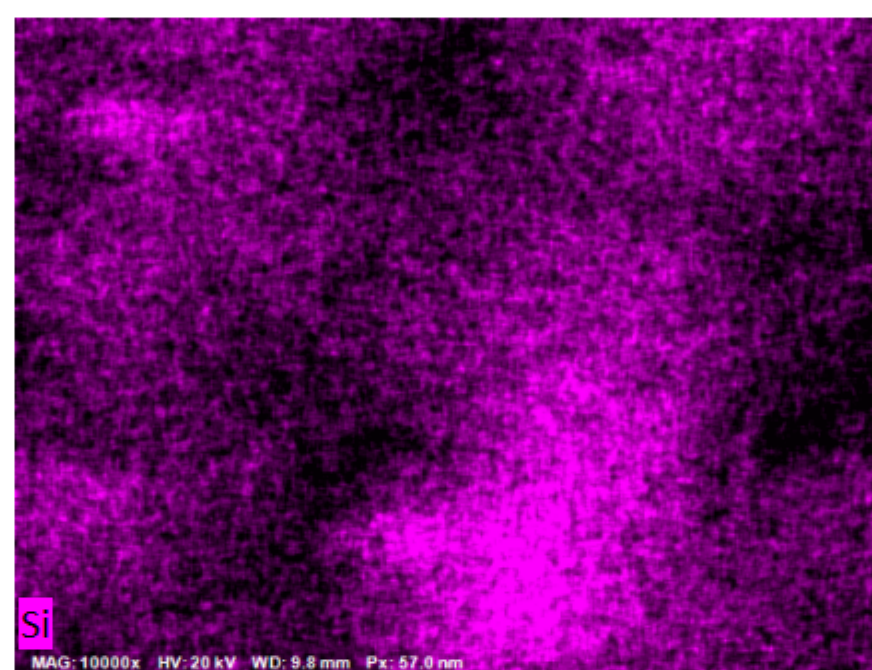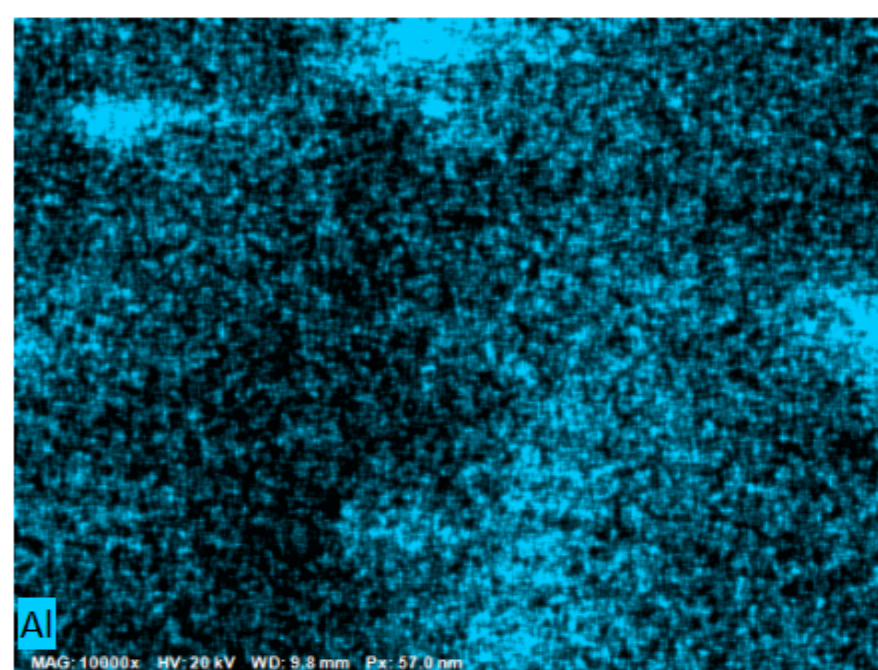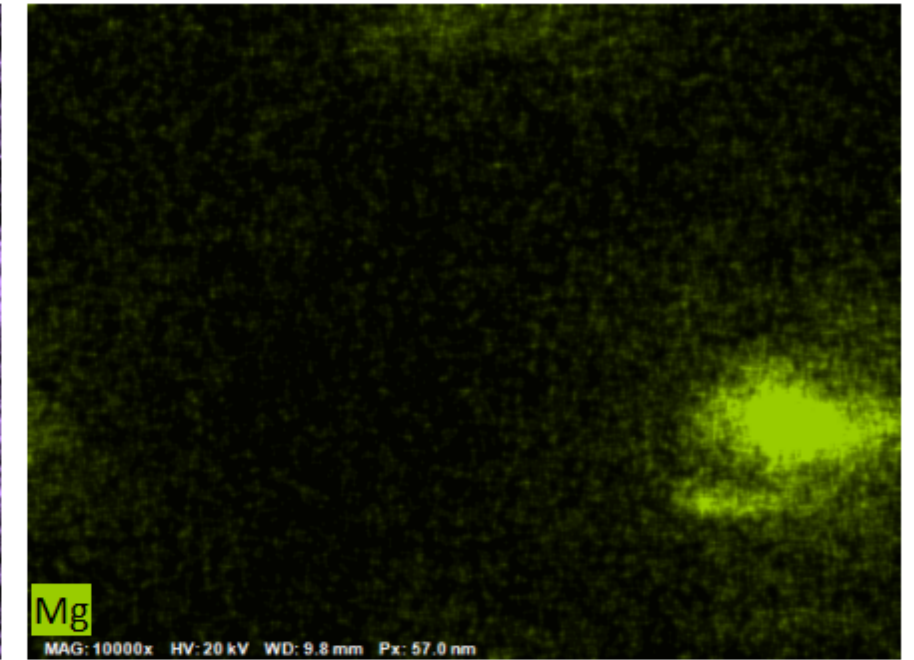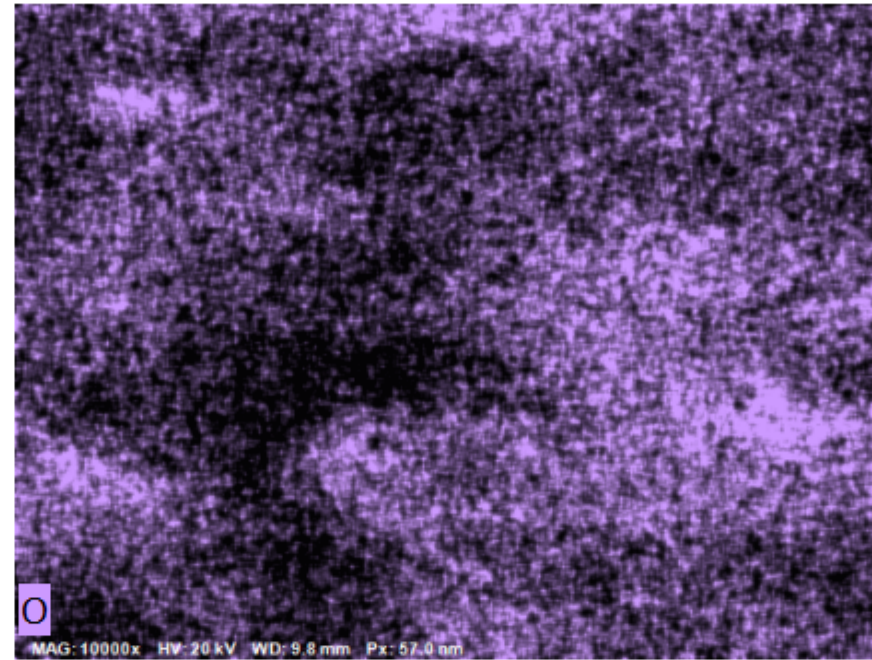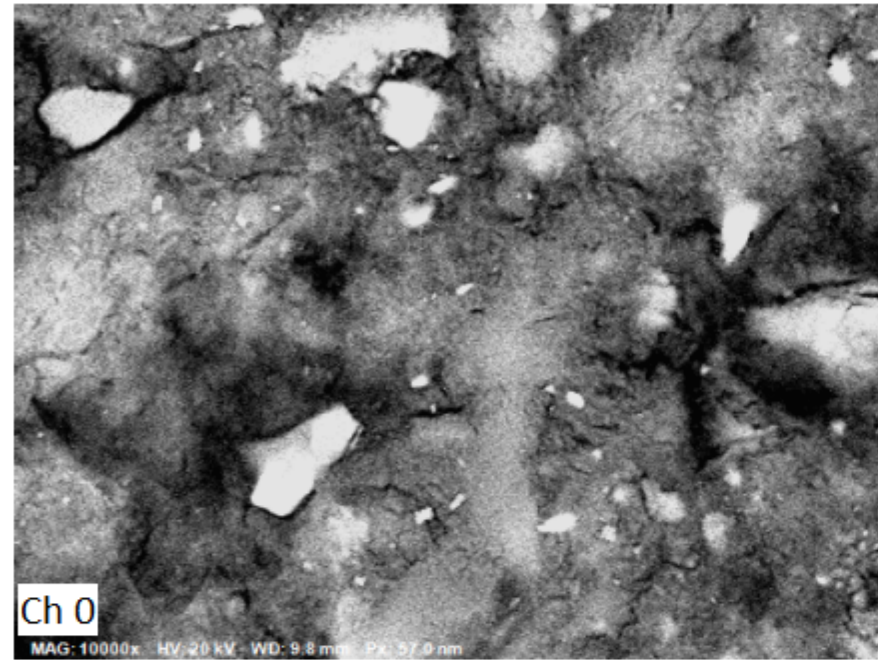

Date	Time	HV [kV]	Mag	WD [mm]
4/9/2020	8:37:51 AM	20.0 keV	10000x	9.8 mm

EDS Report

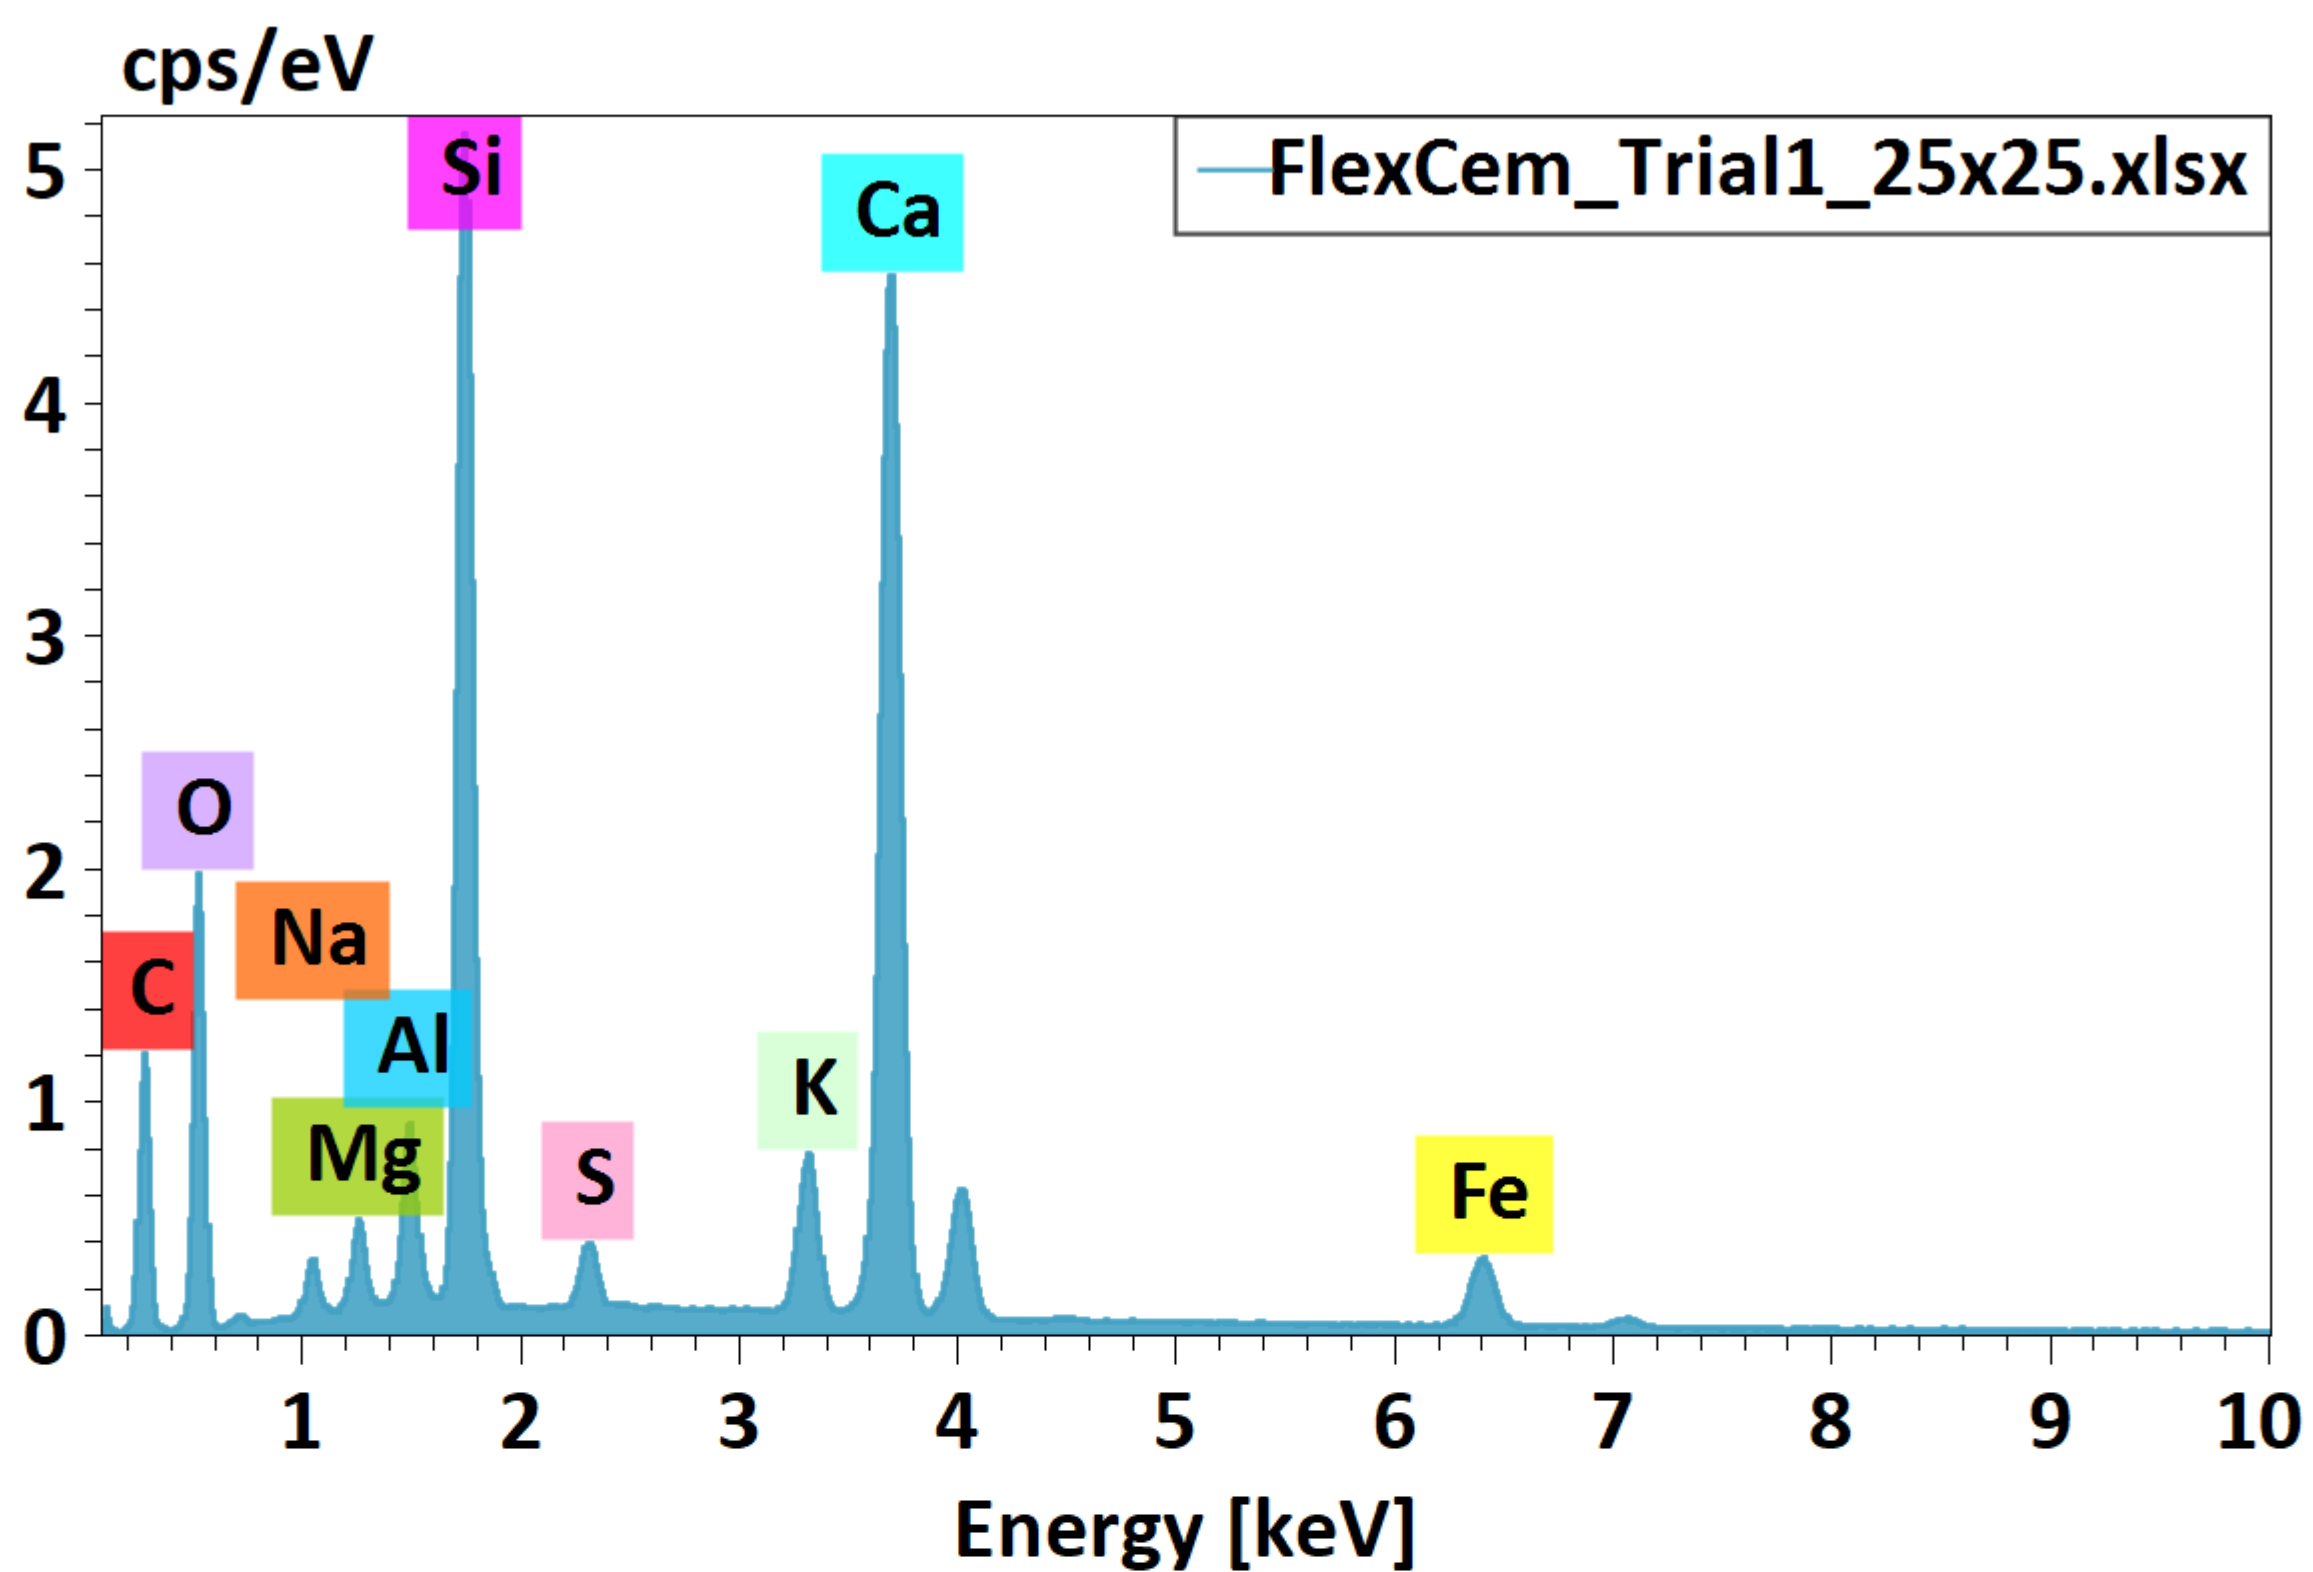

FlexCem_Trial1_25x25.xlsx

Element	At. No.	Mass [%]	Mass Norm. [%]	Atom [%]
Carbon	6	21.10	20.99	33.87
Oxygen	8	34.23	34.06	41.25
Sodium	11	1.03	1.03	0.87
Magnesium	12	1.15	1.15	0.91
Aluminium	13	2.10	2.08	1.50
Silicon	14	11.27	11.22	7.74
Sulfur	16	0.80	0.79	0.48
Potassium	19	2.63	2.62	1.30
Calcium	20	22.44	22.33	10.80
Iron	26	3.75	3.73	1.29
		100.49	100.00	100.00